



| | | | | | | | | | | | | | |
|--------|----------|------------|------|-------|--------|------------------|---------|---------------|--|-------|-------|--|--|
| Datum | | 19.07.2011 | | C 720 | | BETAFENCE | | | | | | | |
| Bearb. | | | | | | | | | | | | | |
| Gepr. | | | | | | | | | | | | | |
| Zust. | Änderung | Datum | Name | Norm | Urspr. | Ers. f. | Ers. d. | Projektseiten | | Blatt | 1 | | |
| | | | | | | | | Gesamt: | | von | 4 Bl. | | |
| | | | | | | | | Aktuell: | | | | | |

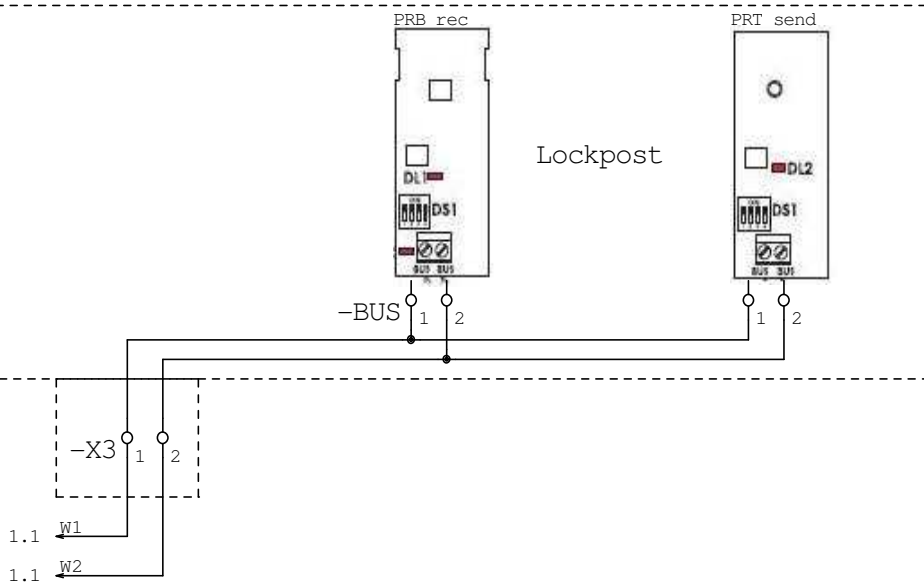

| Dip1 | Dip2 | Dip3 | Dip4 | Re | Type |
|------|------|------|------|----|--|
| OFF | OFF | OFF | OFF | B | OPENING Max. 6 pairs |
| OFF | OFF | OFF | ON | | |
| OFF | OFF | ON | OFF | | |
| OFF | OFF | ON | ON | | |
| OFF | ON | ON | OFF | | |
| OFF | ON | ON | ON | A | CLOSING Max. 7 pairs |
| ON | OFF | OFF | OFF | | |
| ON | OFF | OFF | ON | | |
| ON | OFF | ON | OFF | | |
| ON | OFF | ON | ON | | |
| ON | ON | OFF | OFF | | |
| ON | ON | OFF | ON | | |
| ON | ON | ON | OFF | C | OPENING and CLOSING Max. 2 pairs |
| OFF | ON | OFF | OFF | | |
| OFF | ON | OFF | ON | | |
| ON | ON | ON | ON | / | OPEN PULSE |

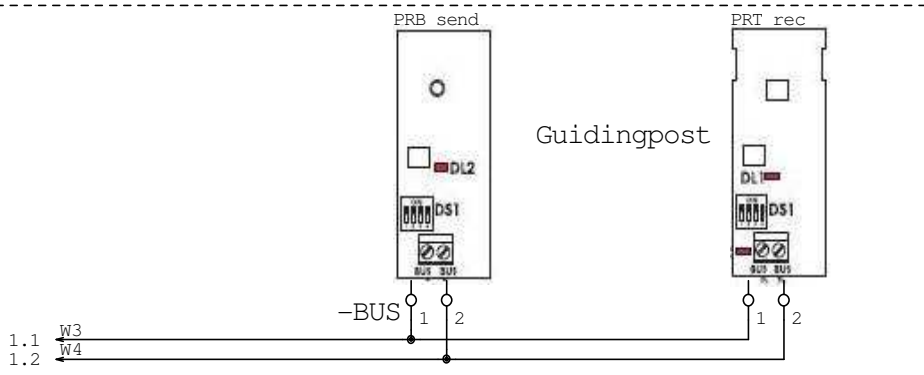

| | |
|---------|------------|
| Datum | 15.07.2011 |
| Bearb. | |
| Gepr. | |
| Zust. | Änderung |
| Datum | Name |
| Norm | |
| Urspr. | Ers. f. |
| Ers. d. | |



Projektseiten
Gesamt: Blatt 2
Aktuell: von 4 Bl.

